

## Generator set data sheet



**Model:** C66 D5L (B3.3)  
**Frequency:** 50 Hz  
**Fuel type:** Diesel

<b>Spec sheet:</b>	S-6282-EN
<b>Noise data sheet (open):</b>	MSP-3033
<b>Airflow data sheet:</b>	MCP-2029

<b>Fuel consumption</b>	<b>Standby</b>				<b>Prime</b>			
	<b>kVA (kW)</b>				<b>kVA (kW)</b>			
Ratings	66 (53)				60 (48)			
Load	<b>1/4</b>	<b>1/2</b>	<b>3/4</b>	<b>Full</b>	<b>1/4</b>	<b>1/2</b>	<b>3/4</b>	<b>Full</b>
US gph	1.2	2.0	3.0	4.1	1.2	1.8	2.7	4.1
L/hr	4.7	7.4	11.4	15.4	4.4	6.9	10.1	13.3

<b>Engine</b>	<b>Standby rating</b>	<b>Prime rating</b>
Engine manufacturer	Cummins	
Engine model	4BTAA3.3-G13	
Configuration	In-line; 4 cylinder diesel	
Aspiration	Turbocharged and after-cooled	
Gross engine power output, kWm	62.6	58
BMEP at set rated load, kPa	1538	1428
Bore, mm	95	
Stroke, mm	115	
Rated speed, rpm	1500	
Piston speed, m/s	5.75	
Compression ratio	19:1	
Lube oil capacity, L	8	
Overspeed limit, rpm	1650	
Regenerative power, kW	N/A	
Governor type	Mechanical as standard	
Starting voltage	12 V DC	

<b>Fuel flow</b>	
Maximum fuel flow, L/hr	45
Maximum fuel inlet restriction, mm Hg (clean filter)	101.6
Maximum fuel inlet temperature, °C	70

<b>Air</b>	<b>Standby rating</b>	<b>Prime rating</b>
Combustion air, m <sup>3</sup> /min	4.64	4.19
Maximum air cleaner restriction, kPa	2.5	

<b>Exhaust</b>		
Exhaust gas flow at set rated load, m <sup>3</sup> /min	10.64	9.76
Exhaust gas temperature, °C	491	483
Maximum exhaust back pressure, kPa	10	

<b>Standard set-mounted radiator cooling</b>		
Ambient design, °C (open genset at 12.7mm H <sub>2</sub> O restriction)	55	
Fan load, kW <sub>m</sub>	2 +/- 1	
Coolant capacity (with radiator), L	10.7	
Cooling system air flow, m <sup>3</sup> /sec @ 12.7 mm H <sub>2</sub> O	1.611	
Total heat rejection, Btu/min	1744	1560
Maximum cooling air flow static restriction, mm H <sub>2</sub> O	25.4	

<b>Weights</b>	<b>Open</b>	<b>Enclosed</b>
Unit dry weight, kg (standard skid)	1019	1423 / 1300**
Unit wet weight, kg (standard skid)	1107	1511 / 1388**
Unit dry weight, kg (optional skid)	1237	1640
Unit wet weight, kg (optional skid)	1325	1728


\*\*Note: Weights and dimensions are for Chassis lifting arrangement option.

<b>Dimensions</b>	<b>Length</b>	<b>Width</b>	<b>Height</b>
Open set dimensions (standard skid)	2050	967	1510
Enclosed set dimensions (standard skid)	2270 / 2276**	975 / 973**	1920 / 1793**
Open set dimensions (optional skid)	2270	967	1720
Enclosed set dimensions (optional skid)	2270	975	2115


\*\*Note: Weights and dimensions are for Chassis lifting arrangement option.

## Genset outline

### Open set

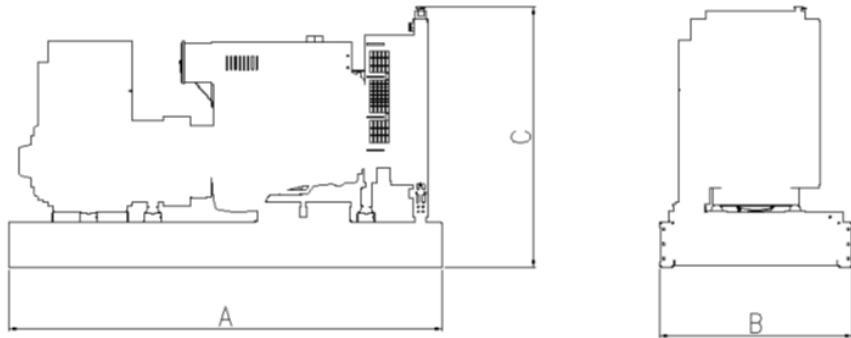

### Enclosed set

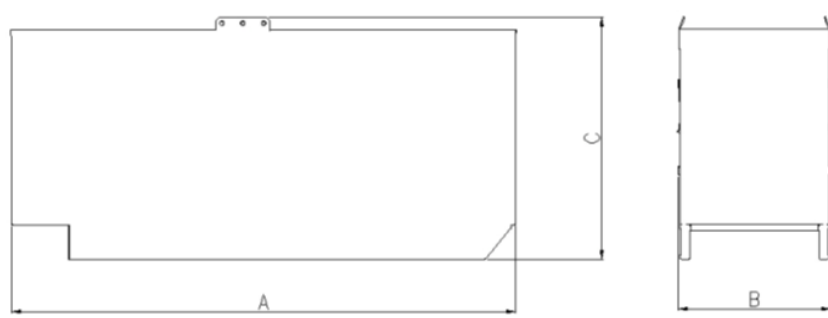

Outlines are for illustrative purposes only. Please refer to the genset outline drawing for an exact representation of this model.

## Alternator data

Connection <sup>1</sup>	Temp rise °C	Duty <sup>2</sup>	Alternator	Voltage
Wye, 3-phase	163/125	S/P	UC122 4F/UC224E	380-415
Wye, 3-phase	150/105	S/P	UC122 4G/UC224F	380-415

### Ratings definitions

<b>Emergency Standby Power (ESP):</b>	<b>Limited-Time running Power (LTP):</b>	<b>Prime Power (PRP):</b>	<b>Base load (Continuous) Power (COP):</b>
Applicable for supplying power to varying electrical load for the duration of power interruption of a reliable utility source. Emergency Standby Power (ESP) is in accordance with ISO 8528. Fuel Stop power in accordance with ISO 3046, AS 2789 and DIN 6271.	Applicable for supplying power to a constant electrical load for limited hours. Limited-Time Running Power (LTP) is in accordance with ISO 8528.	Applicable for supplying power to varying electrical load for unlimited hours. Prime Power (PRP) is in accordance with ISO 8528. Ten percent overload capability is available in accordance with ISO 3046, AS 2789 and DIN 6271.	Applicable for supplying power continuously to a constant electrical load for unlimited hours. Continuous Power (COP) is in accordance with ISO 8528, ISO 3046, AS 2789 and DIN 6271.

### Formulas for calculating full load currents:

#### Three phase output

$$\frac{\text{kW} \times 1000}{\text{Voltage} \times 1.73 \times 0.8}$$

#### Single phase output

$$\frac{\text{kW} \times \text{SinglePhaseFactor} \times 1000}{\text{Voltage}}$$